


**Current Design**, as per NFPA 1142 Standard on Water Supplies for Suburban and Rural Fire Fighting

- Fixed suction, within 3 – 4 years of initial installation Suction is plugged & fouling pump operations

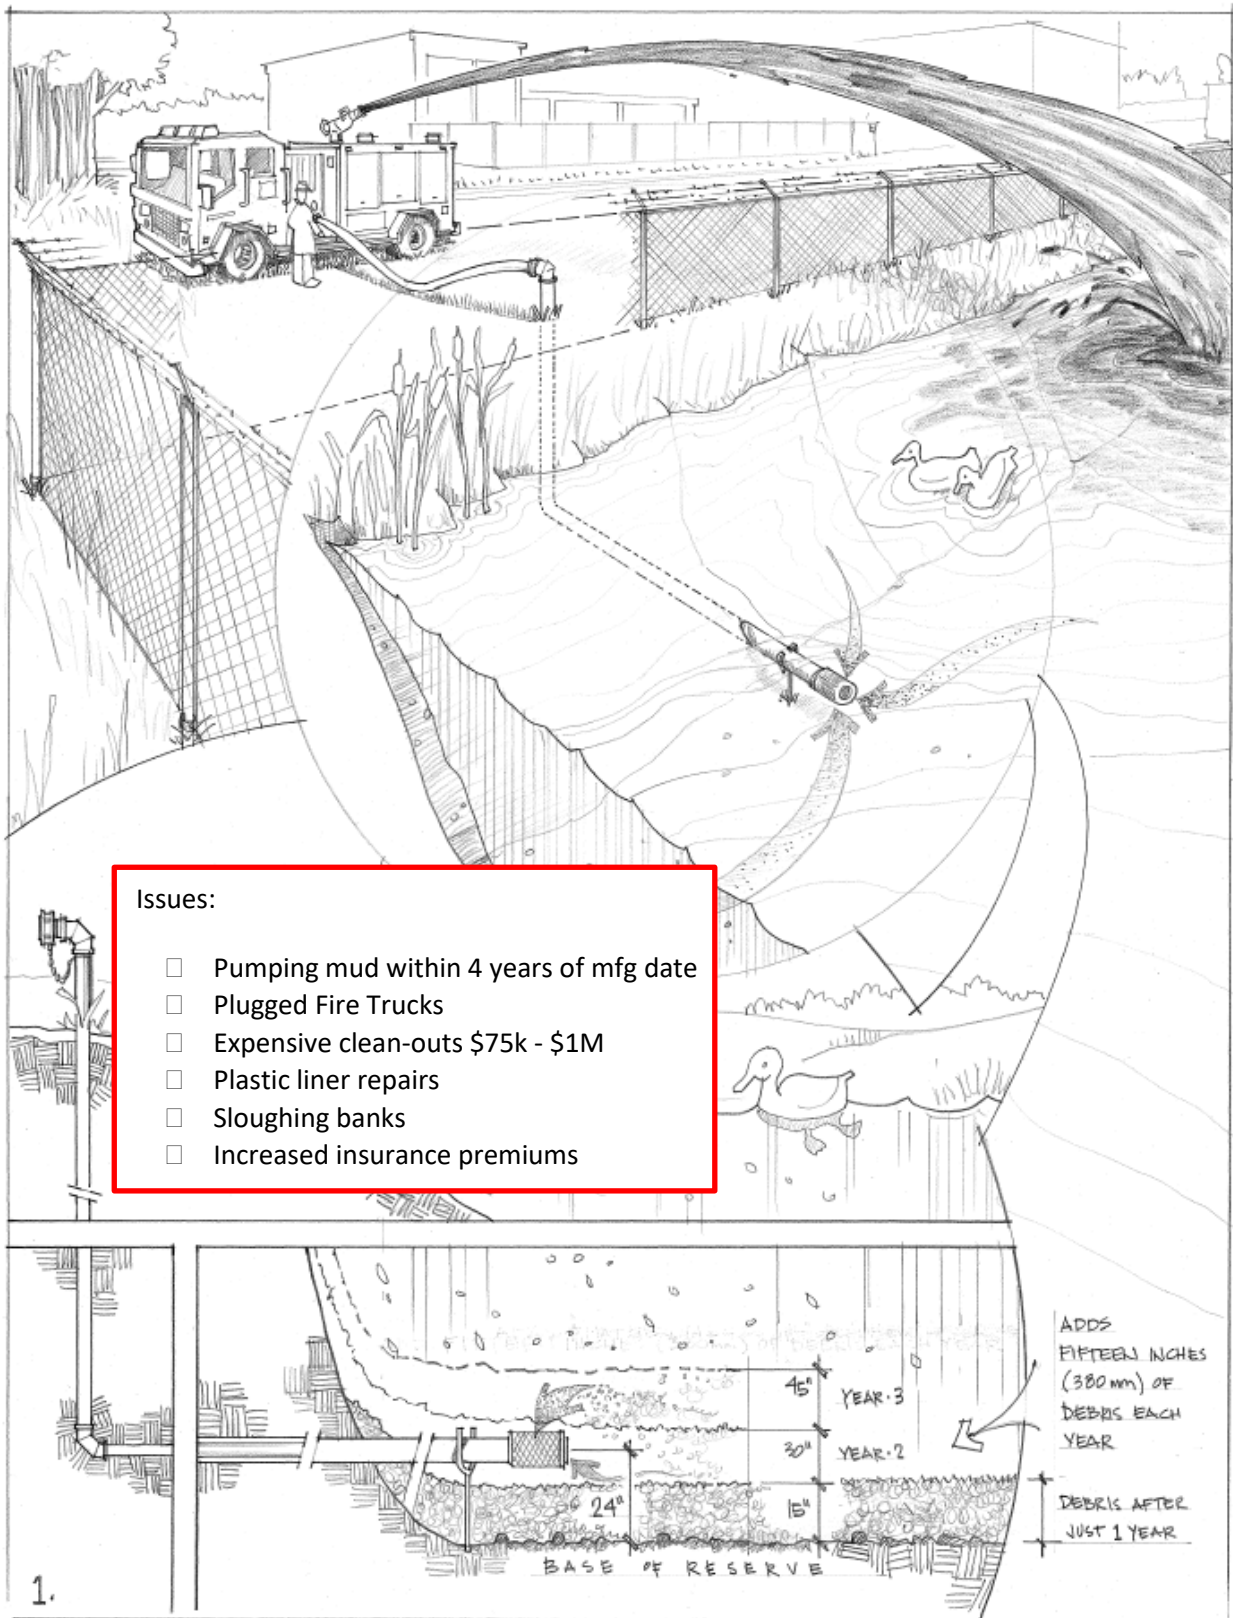

**ACTIVATE**  
**FIRE SAFETY**


[alan@activatefiresafety.com](mailto:alan@activatefiresafety.com)

(403) 815-9527

## Proposed Design

- Floating suction, suspended 6' below water surface, enhanced life expectancy (20-30 year)

Readily accessible water; The key to your peace of mind  
Save lives, minimize property damage, stop trucking water today!

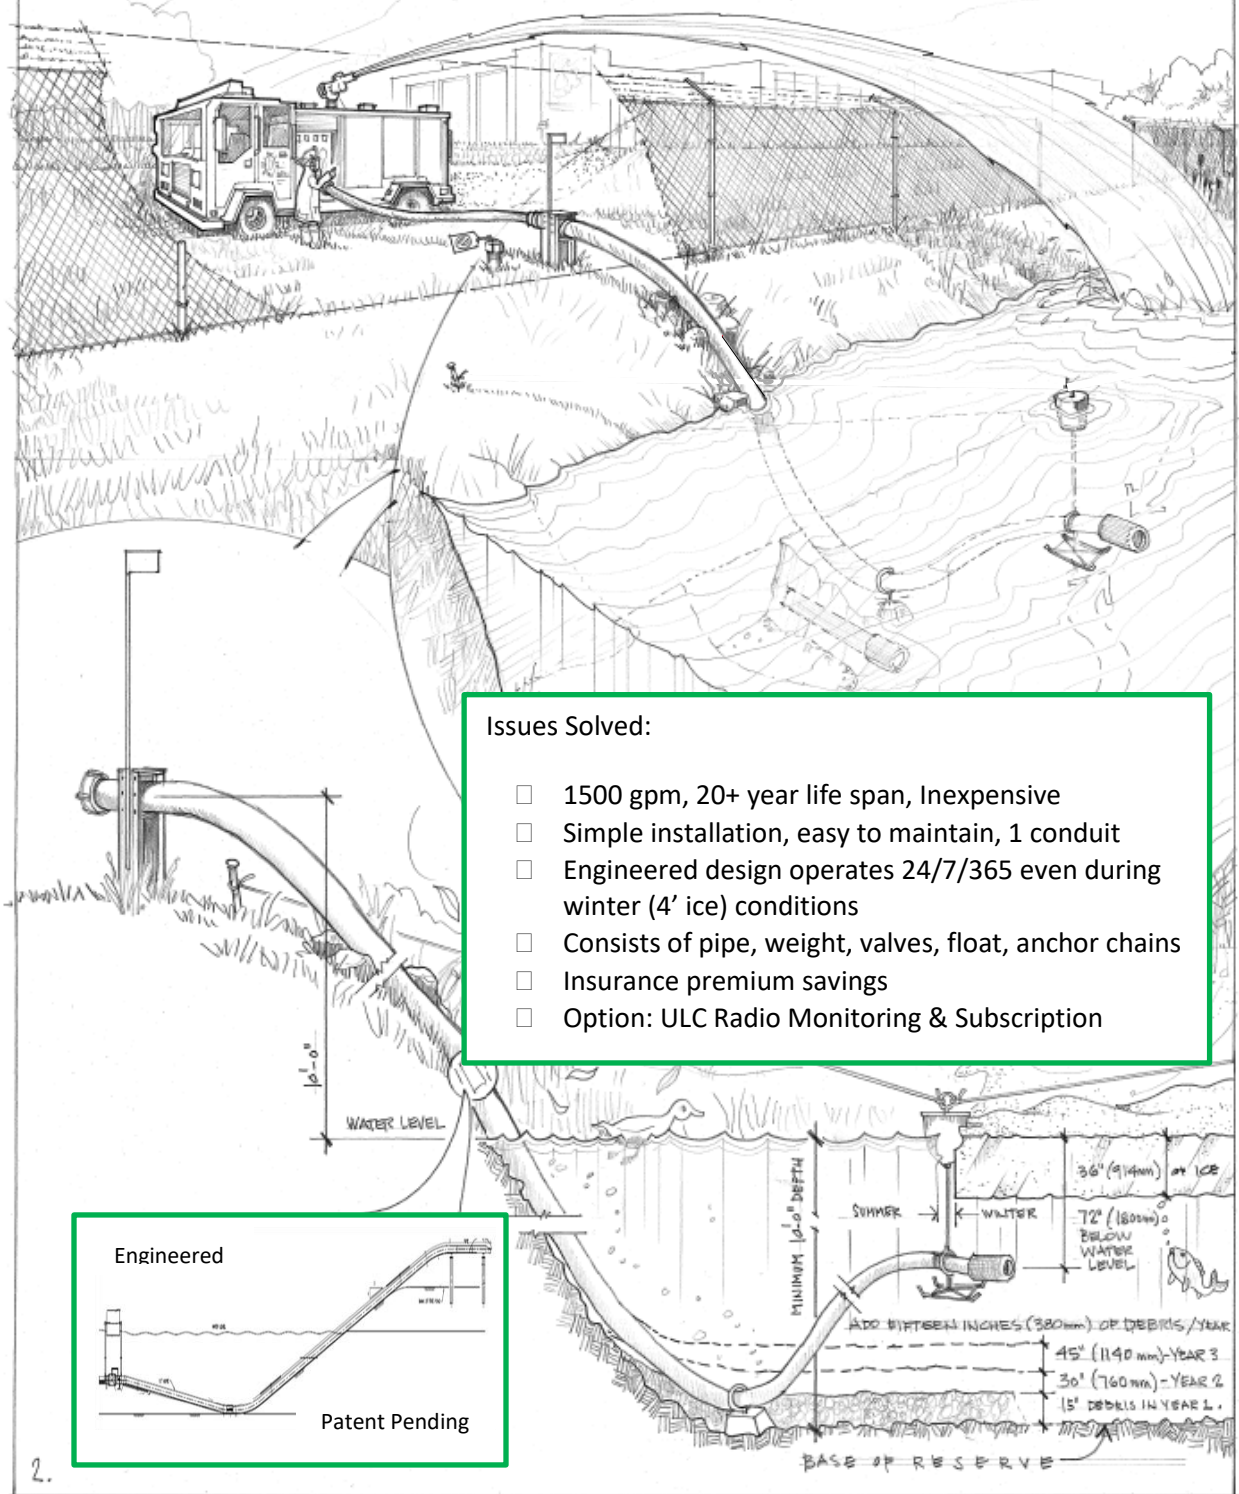

**ACTIVATE**  
**FIRE SAFETY**

[alan@activatefiresafety.com](mailto:alan@activatefiresafety.com)

(403) 815-9527